



Installation instructions for Quick Connect fitting on 12,000 BTU Mini Split.


Protective cap must be removed prior to installation of indoor unit connection.




Pull back on release lever to release protective cap. Please keep clear of protective cap as it is under pressure and will release with some force.




Please retain
protective cover for
future use.

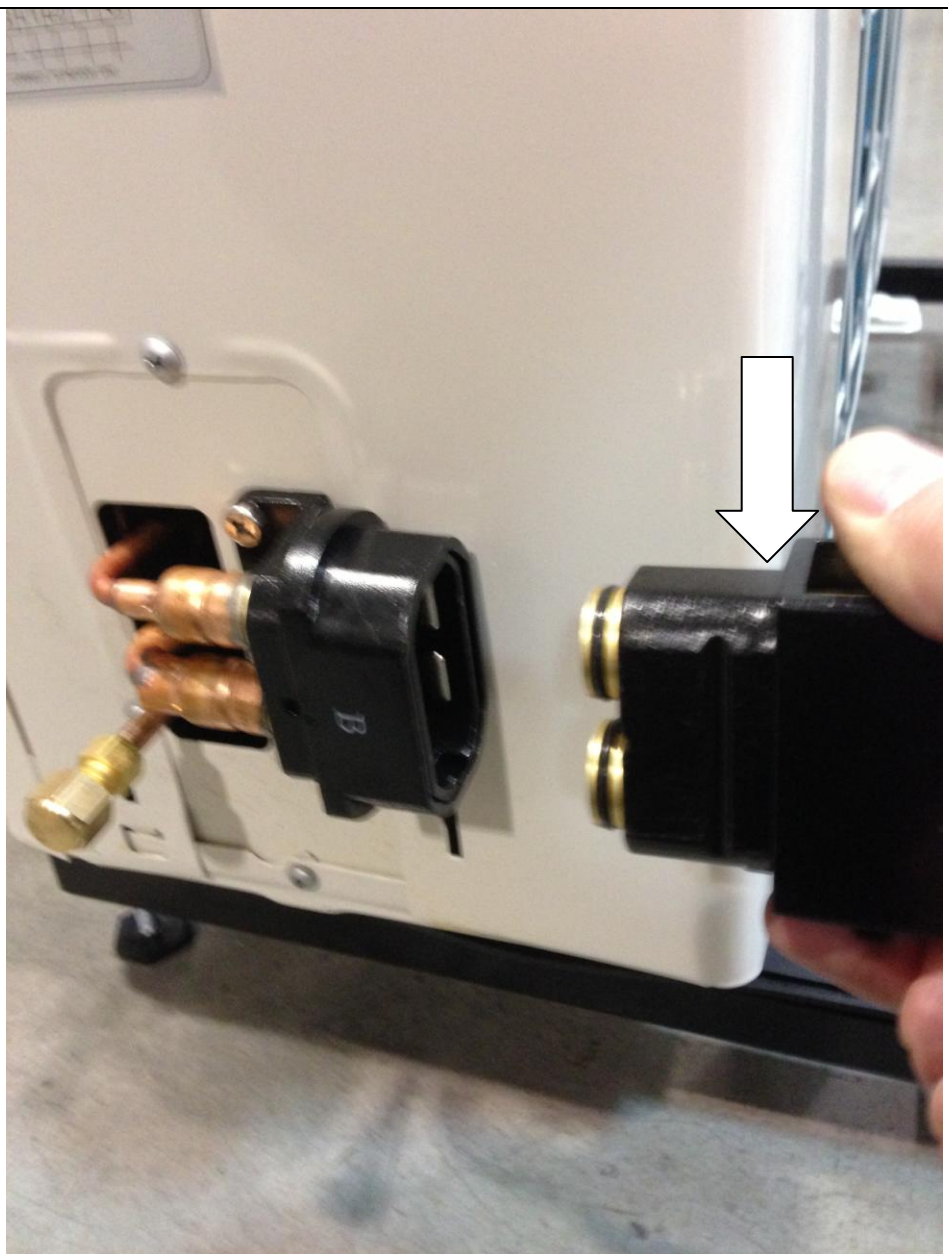


Remove dust cover
from indoor unit
connector.

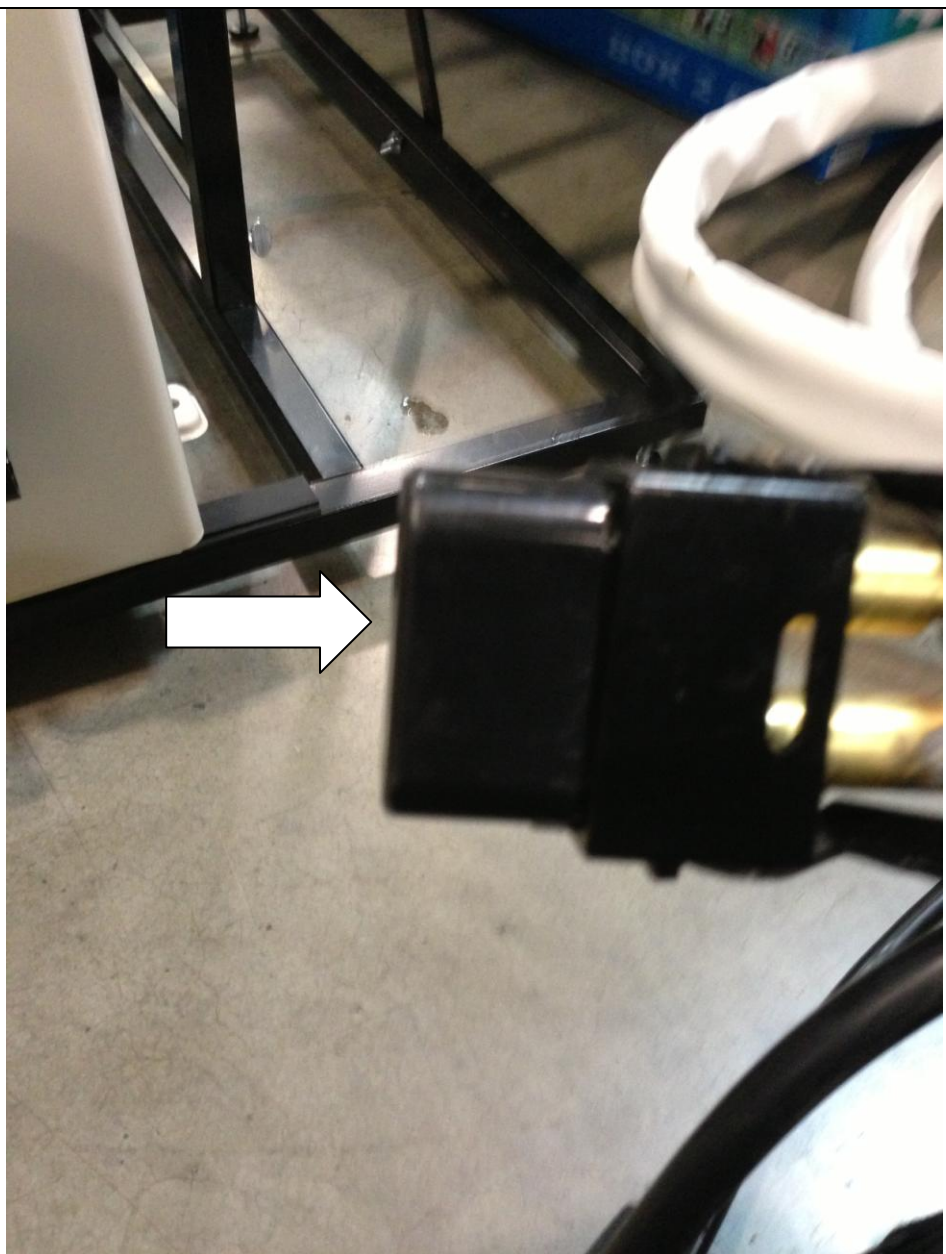

Indoor unit connection
with dust cover
removed.

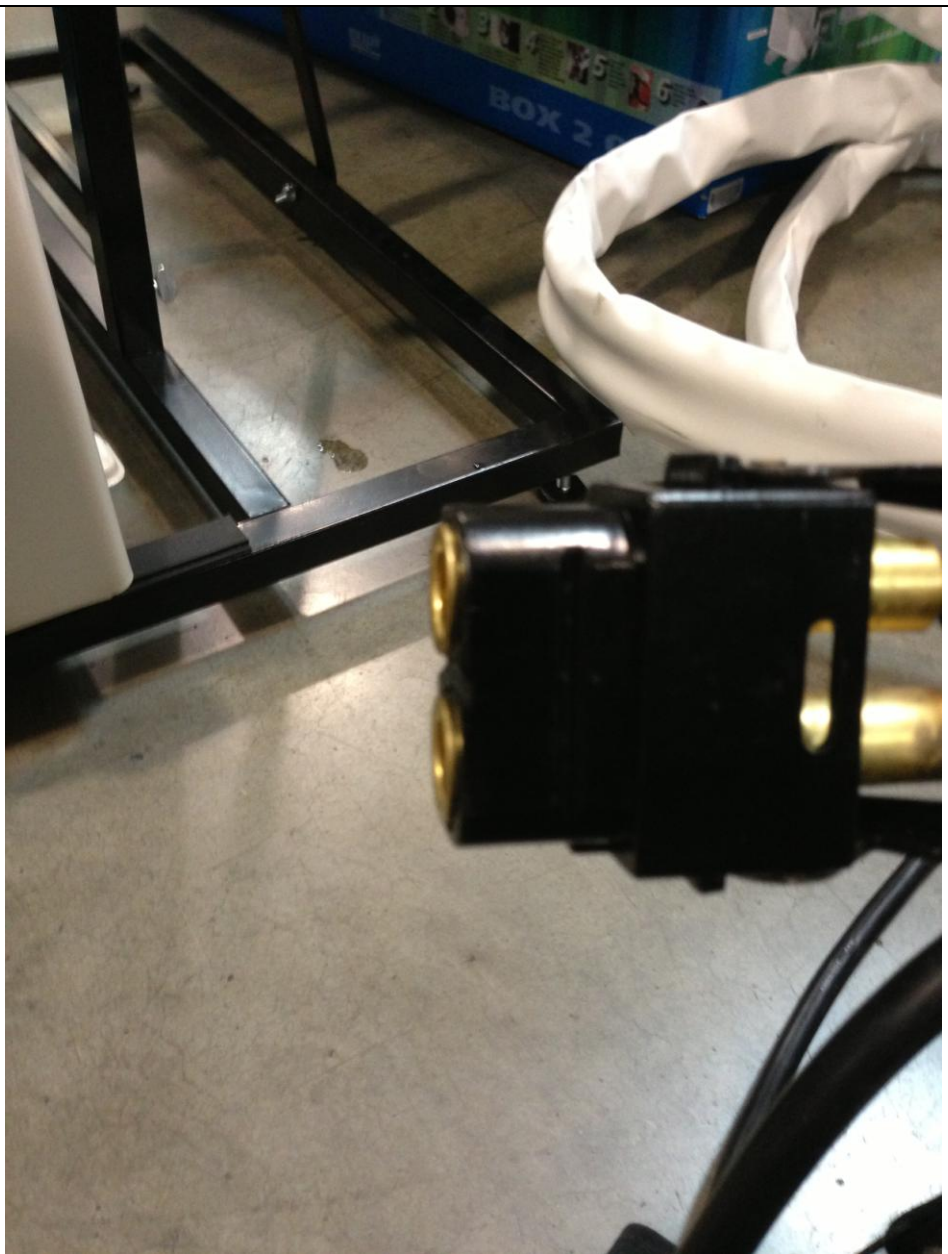

Insert indoor unit connector into the outdoor unit receptacle.

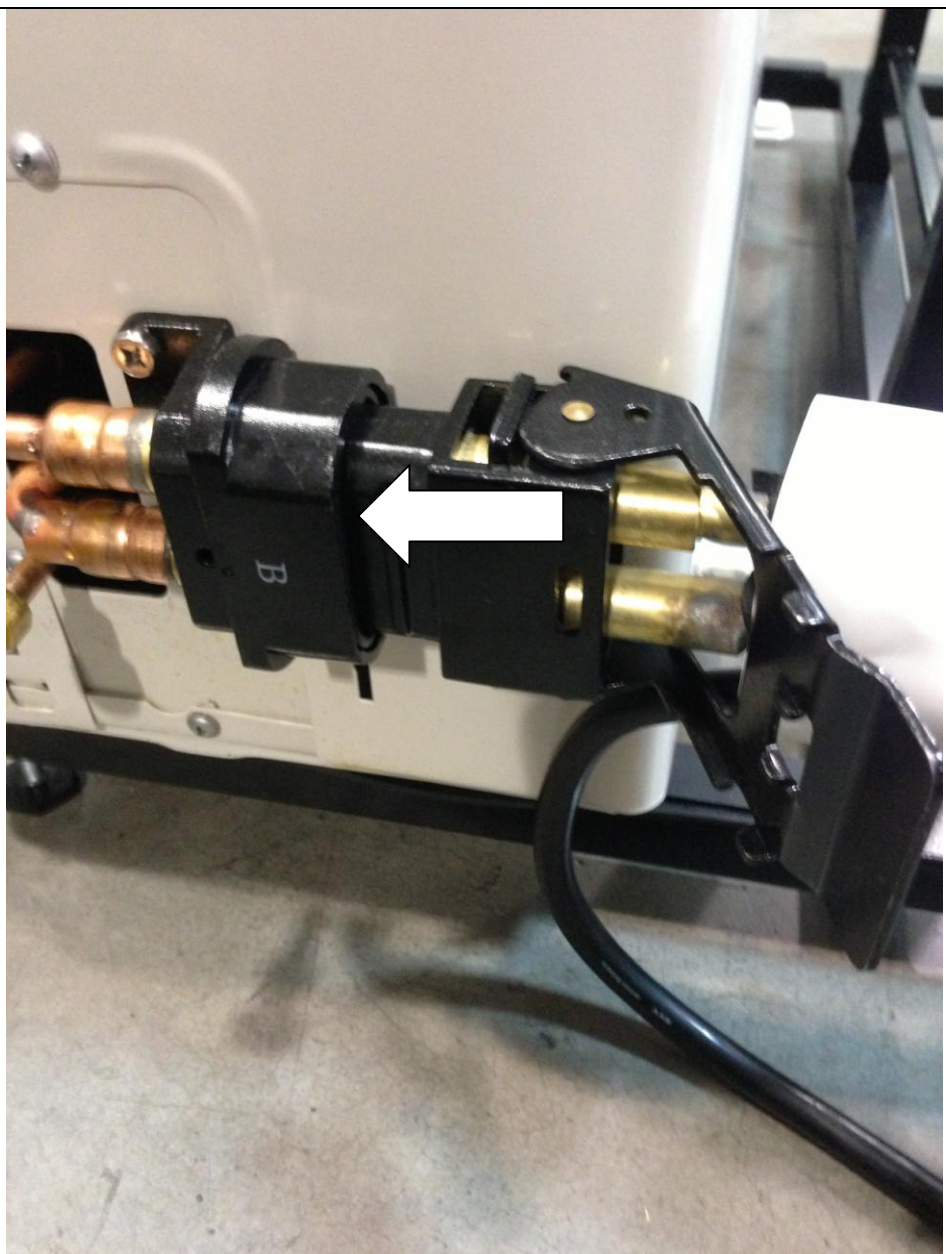

You must insert connector completely into section "B" until it locks into place. A distinct clicking sound will be heard when this is accomplished.



Once connector is in place you must close safety latch completely.

Your refrigerant lines are now connected and ready for operation.

